

For Public Disclosure

GFK-2724A

March 2018

Overview

The PACSystems* RX3i IC695ACC400 Energy Pack is intended for use with one of the following RX3i CPUs: CPE302, CPE305 or CPE310. It is not compatible with any other CPUs.

In the event of loss of system power, the Energy Pack maintains power long enough for the CPU to write its user memory contents to non-volatile storage (flash) memory.

The Energy Pack is mounted on the left side of an RX3i module and is connected to the CPU using cable IC695CBL001. While the system is powered up, the Energy Pack charges from the RX3i 24 Vdc rail via the I695CBL001 cable that connects the CPU to the Energy Pack,

The Energy Pack is compliant with EU RoHS Directive 2011/65/EU using the following exemptions identified in the Annex: 7(a), 7(c)-I and III.

Related Documents

PACSystems RX7i, RX3i & RSTi-EP CPU Reference Manual, GFK-2222

PACSystems RX3i System Manual, GFK-2314

PACSystems Battery and Energy Pack Manual, GFK-2741

Additional documentation for PACSystems RX3i products is available on the Support website: www.geautomation.com/support.

Ordering Information

Description	Catalog Number
RX3i CPU Energy Pack	IC695ACC400
Energy Pack Cable, 3 ft. (0.91m)	IC695CBL001

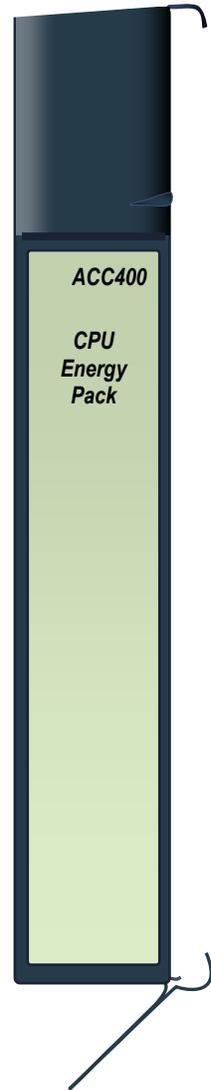


Figure 1: ACC400 Energy Pack

Energy Pack Specifications

Dimensions, including mounting brackets and latch	140mm (5.5") H x 124mm (4.87") D x 25.4mm (1") W
Operating temperature	0 to 60°C (32°F to 140°F)

For product standards, general operating specifications, and installation requirements for the RX3i system, refer to the *PACSystems RX3i System Manual, GFK-2314*.

* indicates a trademark of General Electric Company and/or its affiliates. All other trademarks are the property of their respective owners.

Installation

The Energy Pack is mounted on the left side of an RX3i module. To avoid taking up a backplane slot, it should be mounted on the module (usually a power supply) in slot 0 of the rack. It is connected to the CPU by cable IC695CBL001.

Note that, when mounted on a module in slot 0, the Energy Pack will extend approximately 13mm (0.5") beyond the left side of the backplane.

To install the Energy Pack:

1. Engage the top mounting hooks on the frame of the Energy Pack module as shown in Figure 3.
2. Rotate the bottom of the Energy Pack into place, engaging the bottom hooks. The latch will snap into place.
3. Connect the IC695CBL001 cable from the connector on the bottom of the Energy Pack (Figure 2) to the corresponding connector on the bottom of the CPU.

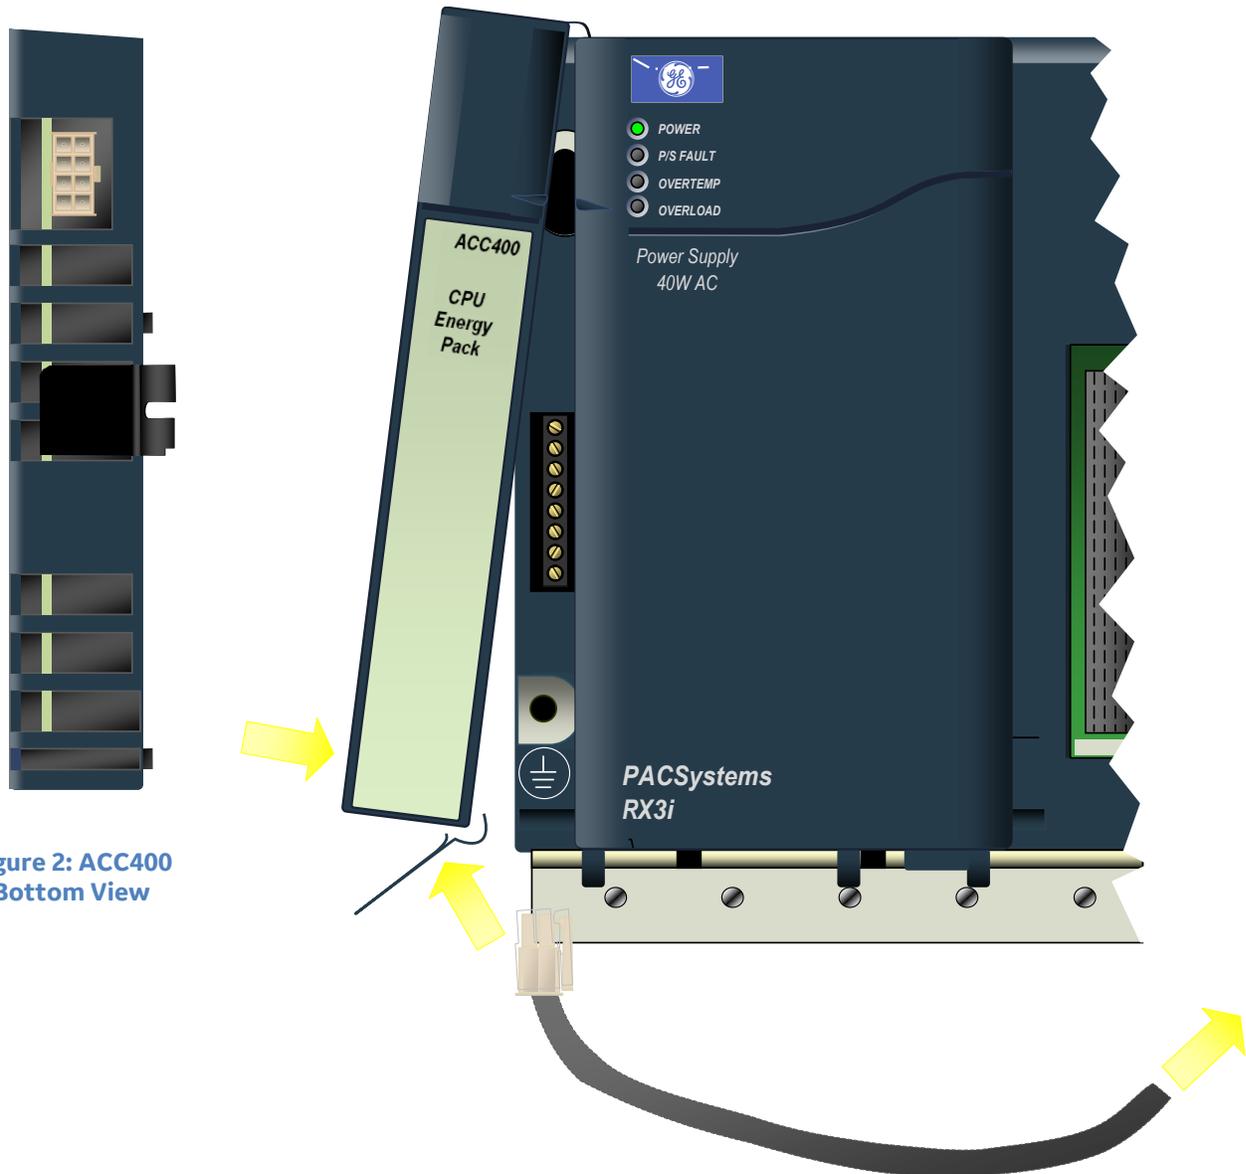


Figure 2: ACC400
Bottom View

Figure 3: Installation of ACC400 Energy Pack: Connect to CPU via Cable IC695CBL001

Operation

Note: When the Energy Pack is powered up for the first time, or is in a system that has been powered down long enough to completely discharge the Energy Pack, it may require a few seconds for it to charge to its operating level. The Energy Pack will report a Charging state to the CPU during this time.

The Energy Pack provides the following status information to the CPU, which the CPU uses to generate LED indications and fault messages. For details on these indications and faults, refer to the CPU user documentation.

Charging	The Energy Pack is charging; not yet charged above the minimum operating voltage.
Fault	A hardware fault exists in the Energy Pack.
Low capacitance	The Energy Pack is near its end of life and should be replaced.
Charged	The Energy Pack is charged above its minimum operating voltage and is ready to support CPU operation.

Replacement Schedule

Replacement schedules for Energy Pack modules can be based on the following estimates.

Energy Pack Typical Life Expectancy

Surrounding Air Temperature	Typical Life Expectancy
0°C	10+ years
10°C	10+ years
20°C	10+ years
30°C	10+ years
40°C	10+ years
50°C	10+ years
60°C	4.5 years

Diagnostics

Note: Any testing of this unit should be performed only by qualified personnel who are trained in electrical safety practices and procedures. This unit is not user-serviceable.

IC695CBL001 Cable

This cable uses straight-through end-to-end wiring (pin 1 to pin 1, etc.).

General Conditions of Safe Use

This product is intended for use with the RX3i system. Its components are considered to be open equipment [having live electrical parts that may be accessible to users] and must be installed in a protective enclosure or incorporated into an assembly that is manufactured to provide safety. As a minimum, the enclosure or assembly shall provide a degree of protection against solid objects up to 12mm (e.g. fingers). This equates to a NEMA/UL Type 1 enclosure or an IP20 rating (IEC60529) providing at least a pollution degree 2 environment.